



MANHOLE RING AND NON-VENTED COVER MARKED "SEWER" - (D & L A-1024, OR EQUAL)

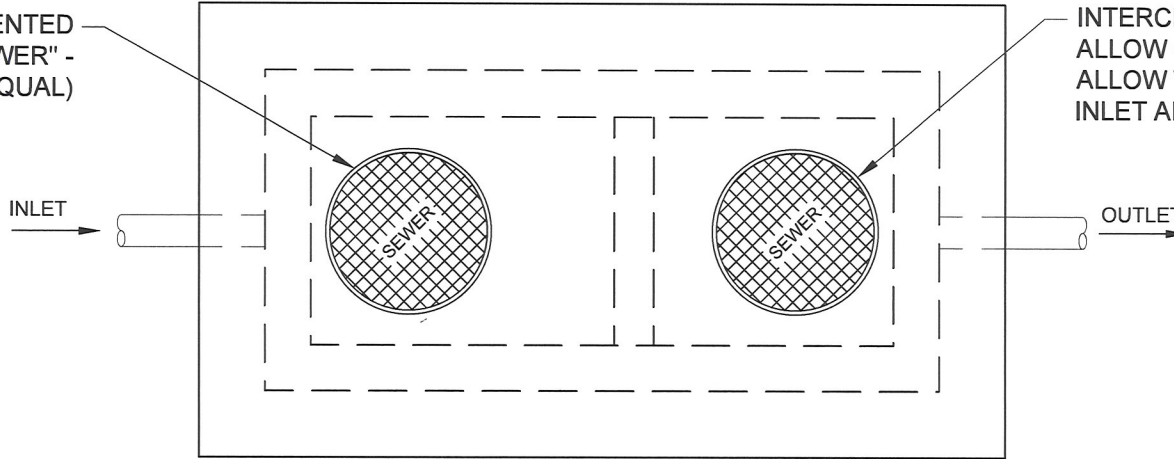

INTERCEPTOR MUST BE LOCATED TO ALLOW CONTINUOUS ACCESS AND ALLOW VIEWING OF AND SAMPLING FROM INLET AND OUTLET TEES (TYP)

PLAN

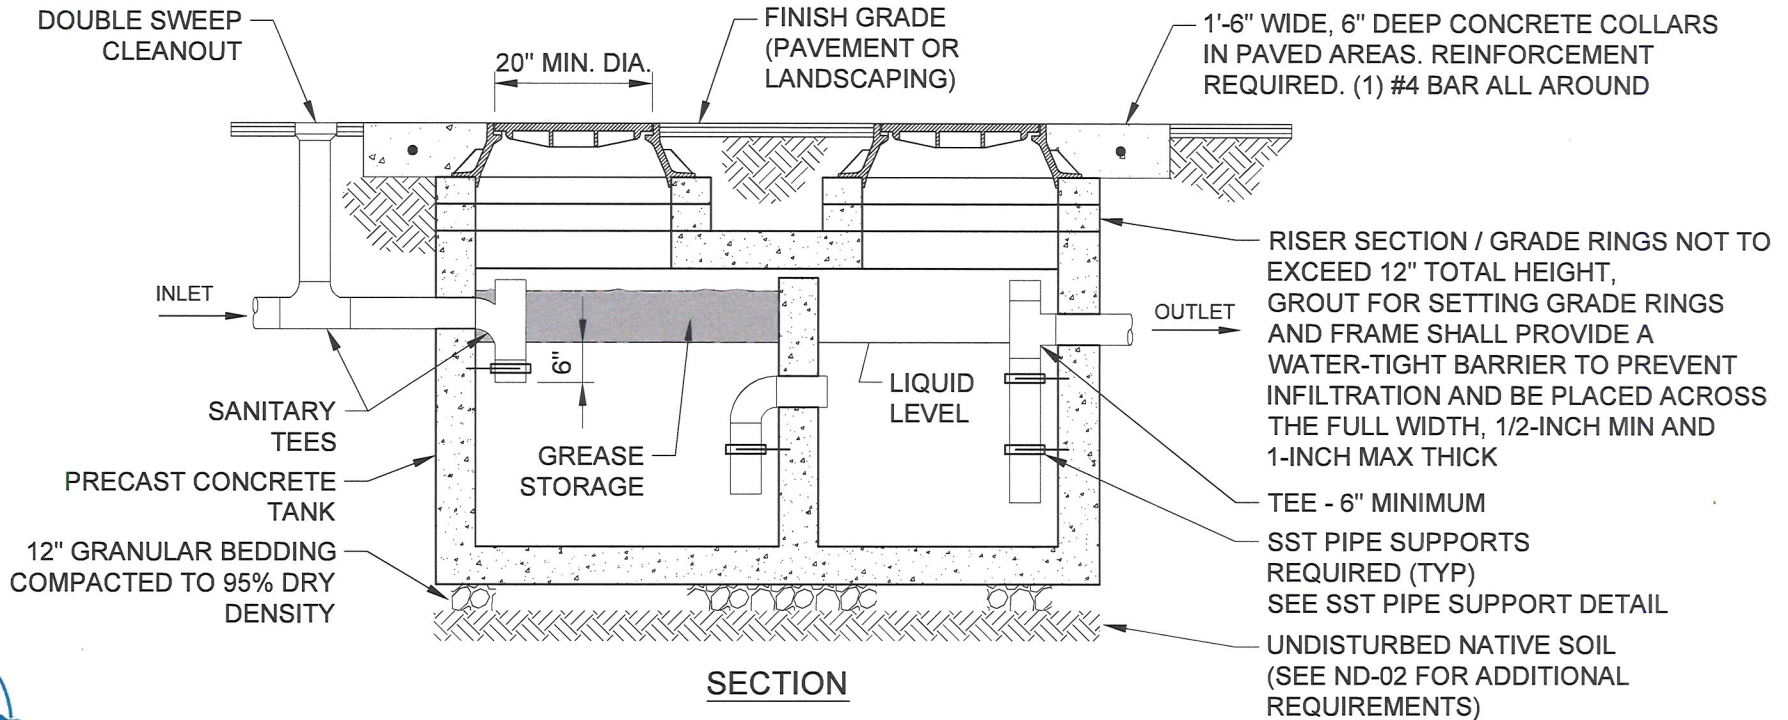


SECTION



NORTH DAVIS SEWER DISTRICT

ND-13 Standard Grease Interceptor 1 of 2

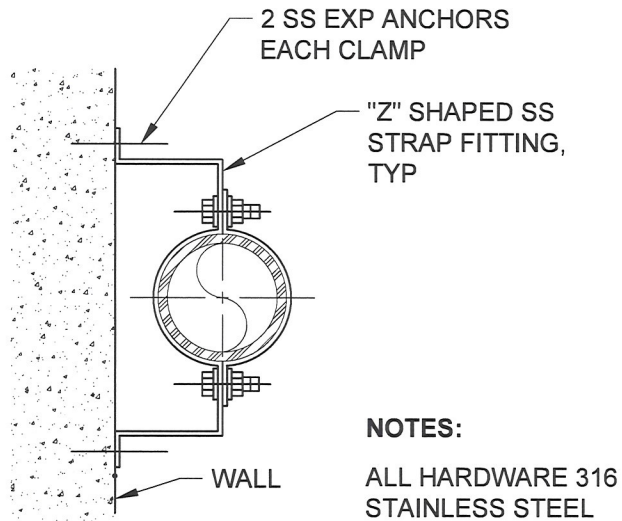

SST PIPE SUPPORT

NOTES:

1. CONTRACTOR MUST NOTIFY THE DISTRICT 48 HOURS BEFORE WORK BEGINS.
2. CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTION OF EXISTING SEWER AND OTHER UTILITIES, PROPER BACKFILLING, COMPACTING, AND SURFACE RESTORATION.
3. GREASE INTERCEPTORS SHALL HAVE A MINIMUM OF TWO COMPARTMENTS. MINIMUM HYDRAULIC VOLUME OF THE TRAP SHALL BE 1,000 GALLONS, UNLESS OTHERWISE APPROVED BY THE DISTRICT.
4. GREASE INTERCEPTOR SHALL BE LOCATED TO BE CONTINUOUSLY AND EASILY ACCESSIBLE FOR INSPECTION AND CLEANING AND AS CLOSE AS PRACTICAL TO THE SOURCE OF WASTEWATER.
5. TRAP, MANHOLE COVERS, AND INTERCEPTOR SHALL BE TRAFFIC RATED.
6. INLET AND OUTLET TEES SHALL BE LOCATED DIRECTLY BELOW MANHOLE ACCESSSES.
7. SEE ND-06 FOR ACCEPTANCE TESTING, FINAL COMPLETION, AND WARRANTY REQUIREMENTS.

